



An Introduction to Activated Sludge Wastewater Treatment Plants

By

J. Paul Guyer, P.E., R.A.

PDHLibrary Course No 0010084
3 PDH HOURS

An Introduction to Activated Sludge Wastewater Treatment Plants



J. Paul Guyer, P.E., R.A.

Paul Guyer is a registered civil engineer, mechanical engineer, fire protection engineer and architect with 35 years of experience designing buildings and related infrastructure. For an additional 9 years he was a principal staff advisor to the California Legislature on capital outlay and infrastructure issues. He is a graduate of Stanford University and has held numerous national, state and local offices with the American Society of Civil Engineers, Architectural Engineering Institute and National Society of Professional Engineers.

CONTENTS

1. INTRODUCTION
2. ACTIVATED SLUDGE PROCESSES
3. CLOSED-LOOP REACTOR DESIGN CRITERIA
4. EXAMPLE CALCULATIONS
5. REFERENCES
6. BIBLIOGRAPHY

(This publication is adapted from the *Unified Facilities Criteria* of the United States government which are in the public domain, have been authorized for unlimited distribution, and are not copyrighted.)

(Figures, tables and formulas in this publication may at times be a little difficult to read, but they are the best available. **DO NOT PURCHASE THIS PUBLICATION IF THIS LIMITATION IS NOT ACCEPTABLE TO YOU.**)

1. GENERAL CONSIDERATIONS. The activated sludge process has been employed extensively throughout the world in its conventional form and modified forms, all of which are capable of meeting secondary treatment effluent limits. This publication presents the different modifications of the conventional activated sludge process, including general bases for design, methods of aeration, and design factors for aeration tanks, final sedimentation units and sludge handling systems. Figures 1 through 4 are schematic diagrams of the conventional and modified processes. The characteristics and obtainable removal efficiencies for these processes are listed in table 3. All designed processes will include preliminary treatment consisting of bar screen as a minimum and, as needed, comminutor, grit chamber, and oil and grease removal units.

2. ACTIVATED SLUDGE PROCESSES

2.1 CONVENTIONAL ACTIVATED SLUDGE. In a conventional (plug-flow) activated sludge plant (fig 1), the primary-treated wastewater and acclimated micro-organisms (activated sludge or biomass) are aerated in a basin or tank. After a sufficient aeration period, the flocculent activated sludge solids are separated from the wastewater in a secondary clarifier. The clarified wastewater flows forward for further treatment or discharge. A portion of the clarifier underflow sludge is returned to the aeration basin for mixing with the primary- treated influent to the basin and the remaining sludge is wasted to the sludge handling portion of the treatment plant. The portion recirculated is determined on the basis of the ratio of mixed liquor volatile suspended solids (MLVSS) to influent wastewater biochemical oxygen demand which will produce the maximum removal of organic material from the wastewater. Recirculation varies from 25 to 50 percent of the raw wastewater flow, depending on treatment conditions and wastewater characteristics.

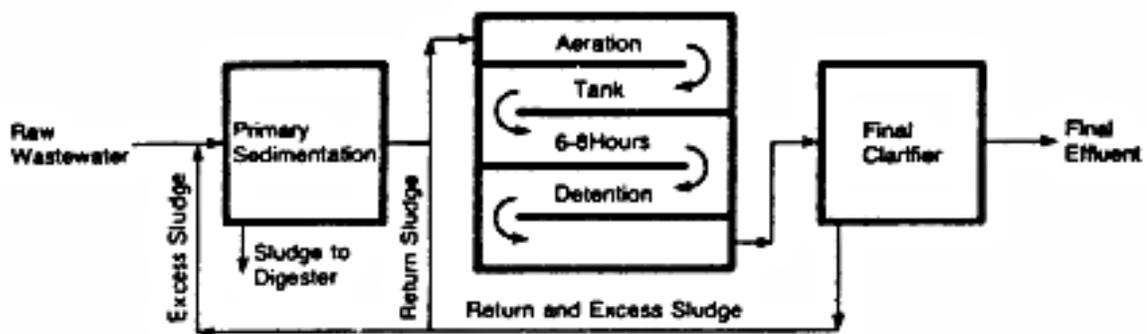


Figure 1

Conventional plug flow activated sludge flow diagram

2.2 STEP AERATION. In this process (fig 2), the influent wastewater is introduced at various points along the length of the aeration tank. Sludge return varies between 25 and 50 percent. Aeration or the oxygen requirement during step aeration (3 to 7 hours) is about half that required for the conventional process. This results from a more

effective biomass utilization in the aeration basin, allowing organic loadings of 30 to 50 pounds biochemical oxygen demand per 1,000 cubic feet per day as compared to loadings of 30 to 40 pounds biochemical oxygen demand per 1,000 cubic feet per day permitted for conventional systems.

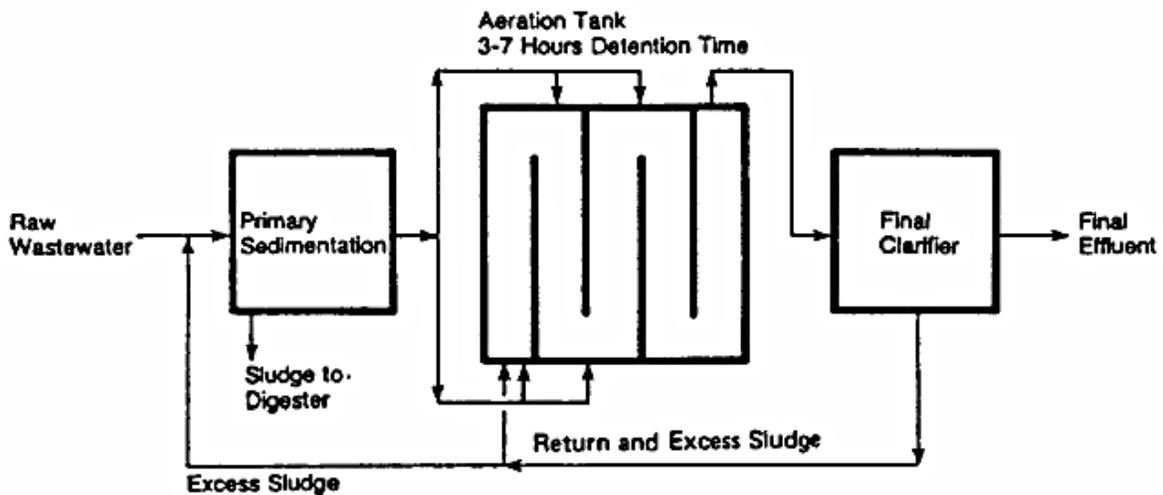


Figure 2
Step aeration flow diagram

2.3 CONTACT STABILIZATION. The contact stabilization activated sludge process (fig 3) is characterized by a two-step aeration system. Aeration of short duration ($\frac{1}{2}$ to 2 hours) is provided in the contact tank where raw or primary-settled wastewater is mixed with the activated sludge in the contact tank. The effluent from the contact tank is then settled in a final settling tank. The settled activated sludge to be recycled from the final clarifier is drawn to a separate re-aeration in a stabilization basin for 3 to 8 hours of aeration time. It is then returned to the contact aeration basin for mixing with the incoming raw wastewater or primary settled effluent. In addition to a shorter wastewater aeration time, the contact stabilization process has the advantage of being able to handle greater shock and toxic loadings than conventional systems because of the buffering capacity of the biomass in the stabilization tank. During these times of abnormal loadings, most of the activated sludge is isolated from the main stream of the plant flow. Contact stabilization plants will not be used where daily variations in

hydraulic or organic loadings routinely exceed a ratio of 3:1 on consecutive days or for plants with average flows less than 0.1 million gallons per day without prior approval of the owner.

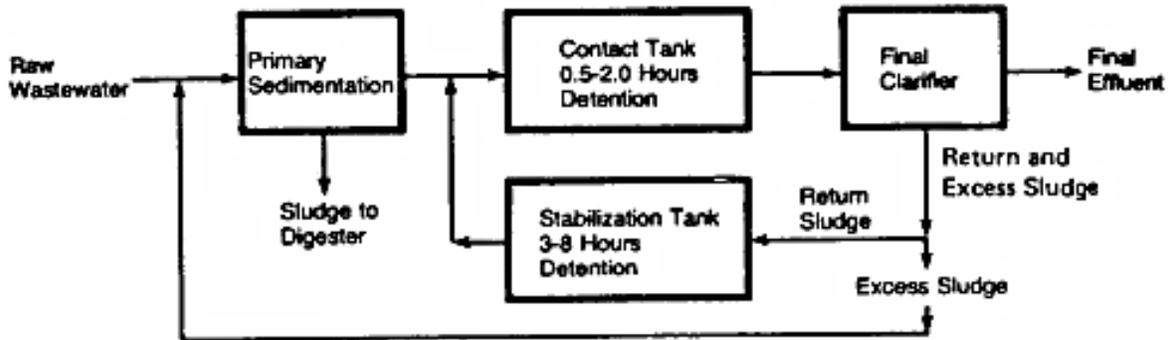


Table 3

Contact stabilization flow diagram

2.4 COMPLETELY-MIXED ACTIVATED SLUDGE. In the completely-mixed process (fig 4), influent wastewater and the recycled sludge are introduced uniformly through the aeration tank. This allows for uniform oxygen demand throughout the aeration tank and adds operational stability when treating shock loads. Aeration time ranges between 3 and 6 hours. Recirculation ratios in a completely-mixed system will range from 50 to 150 percent.


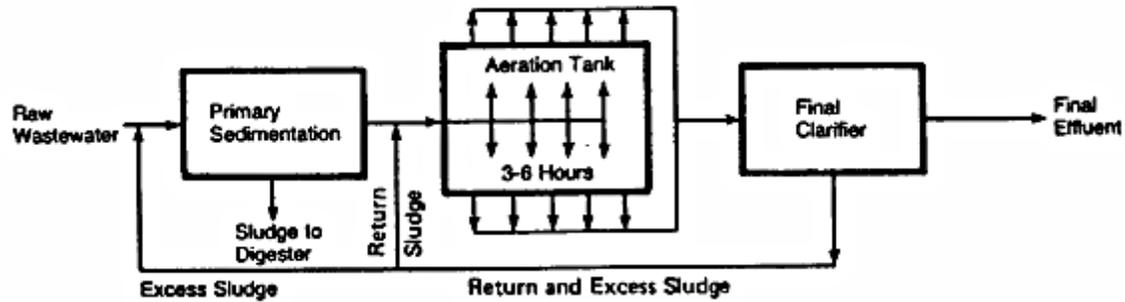


Figure 4

Completely-mixed process flow diagram

2.5 EXTENDED AERATION. Extended aeration activated sludge plants are designed to provide a 24-hour aeration period for low organic loadings of less than 20 pounds biochemical oxygen demand per 1,000 cubic feet of aeration tank volume. This approach, which can be used for treatment plants of less than 0.1 million gallons per day capacity, reduces the amount of sludge being wasted for disposal.

2.6 OXIDATION DITCH. The closed-loop reactor, also known as an oxidation ditch (fig 5), is a form of the extended aeration process. The wastewater is propelled around an oval racetrack-configured basin by mechanical aerator/mixing devices located at one or more points along the basin. These devices can be either brush aerators, surface aerators or jet aerators. The velocity in the basin is designed to be between 0.8 and 1.2 feet per second. The closed-loop reactor is the preferred type of activated sludge system for many installations.

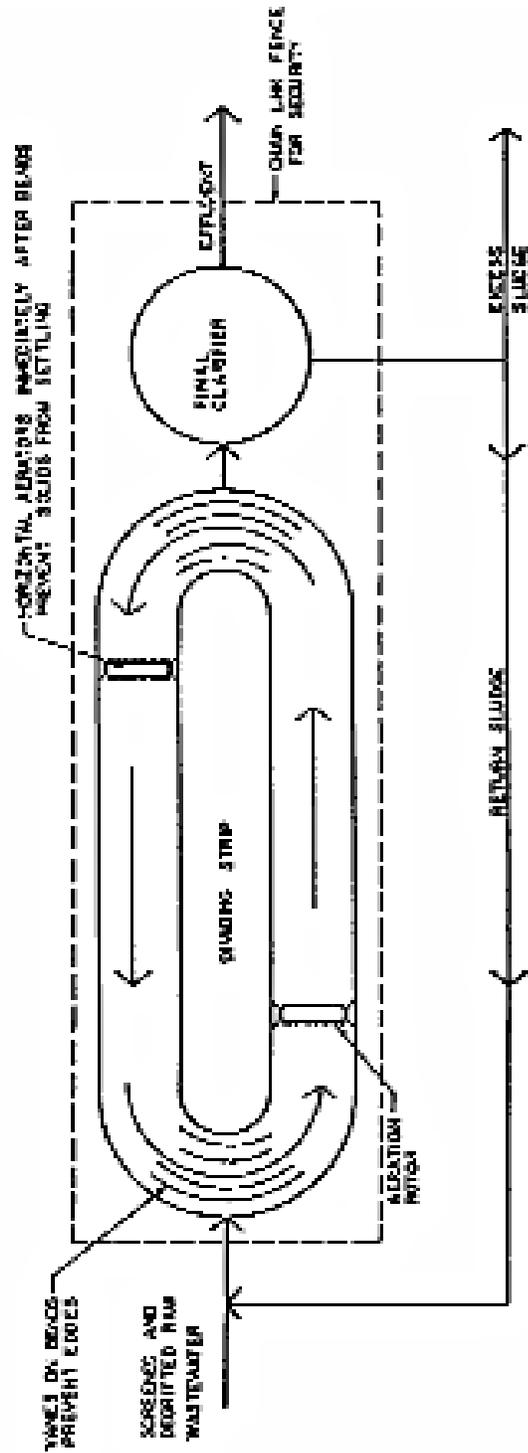

CLOSED LOOP REACTOR TREATMENT SYSTEM

NOTES:

- 1) METALLIC WINGS ON BEHIND AND HORIZONTAL ADJUSTORS IMMEDIATELY AFTER BEAMS.
- 2) TRAVEL TIME BETWEEN REACTORS 100-3-4 MIN.
- 3) NO PRIMARY CLARIFIERS ARE REQUIRED.
- 4) MLSS 40-5000 - 50000 Mg/L.
- 5) HYDRAULIC RETENTION 200-3-4 HRS.

Figure 5

Closed-loop reactor treatment system

3. CLOSED-LOOP REACTOR DESIGN CRITERIA

3.1 GENERAL. Table 1 presents the design criteria to be used for the design of a closed-loop reactor plant.

Parameter	Value
Primary clarifier	None required
Hydraulic retention time	18-24 hrs
Sludge retention time	20-30 days
Secondary clarifier	
Overflow rate	450 gpd/sq ft
Solids loading rate	15 lb/sq ft/day

Table 1
Closed-loop reactor design criteria

3.2 AERATION TANK DESIGN. All oxidation ditch plants use looped channels or ditches. A looped channel with a partition in the middle may be shaped like an oval or a concentric ring. The design engineer may adopt a specific channel configuration and flow scheme recommended by the equipment manufacturer or supplier.

3.2.1 CHANNEL DEPTH. The number of loops and the channel depth are dependent upon the size of the plant. A shallow channel, less than 14 feet deep, is used for smaller plants with unlimited land area available. A deep channel, greater than 20 feet, should be designed for larger plants or to conserve heat.

3.2.2 NUMBER OF CHANNELS. Multiple-channel or multiple-loop is the preferable design so that part of the plant can be shut down for repair and maintenance.

3.2.3 DRAINAGE. A drain should be provided for each channel. This provision allows mixed liquor or accumulated grit material to be drained from the channel without

expensive pumping. Many oxidation ditch plants do not have drains in their channels and are having maintenance problems.

3.2.4 CHANNEL LINING. Deep channels are to be built exclusively with reinforced concrete. A concrete liner can be placed against the earth backing in shallow channels by pouring concrete or gunite (shotcrete) to a thickness of 3 to 4 inches. The concrete or gunite should provide a minimum compressive strength of 3,000 pounds per square inch in 28 days.

3.3 AERATION. Depending on the width and depth of the channel, various types of aerators can meet the oxygenation and mixing requirements.

3.3.1 ROTOR AERATOR. A rotor aerator is a horizontal shaft with protruding blades which rotates, thereby transferring oxygen into the wastewater and propelling it around the ditch. Figure 6 illustrates a typical horizontal-shaft aerator. The minimum length of shaft is 3 feet; the maximum length of shaft is 30 feet. This type of aerator is suitable for shallow channels.

3.3.2 INDUCTION AERATOR. This type of aerator, which is available in various sizes, draws the mixed liquor and air down a U-tube and discharges it for a distance downstream in the channel. Compressed air at low pressure can be injected near the top of the down-draft tube to enhance oxygenation. A bulkhead (which should be partially opened at the bottom) is required to separate the channel to maintain the flow circulation. This type of aerator is suitable for shallow to moderately deep channels.

3.3.3 JET AERATION. Jet aeration is specifically designed for deep channels. Both air and the mixed liquor are pressurized (by aspirator pumping) into a mixing chamber from where the mixture is discharged as a jet stream into the surrounding channel liquid. Deep channels are used to take advantage of better oxygen transfer. Figure 7 illustrates a jet aerator, among various other types of aerators.


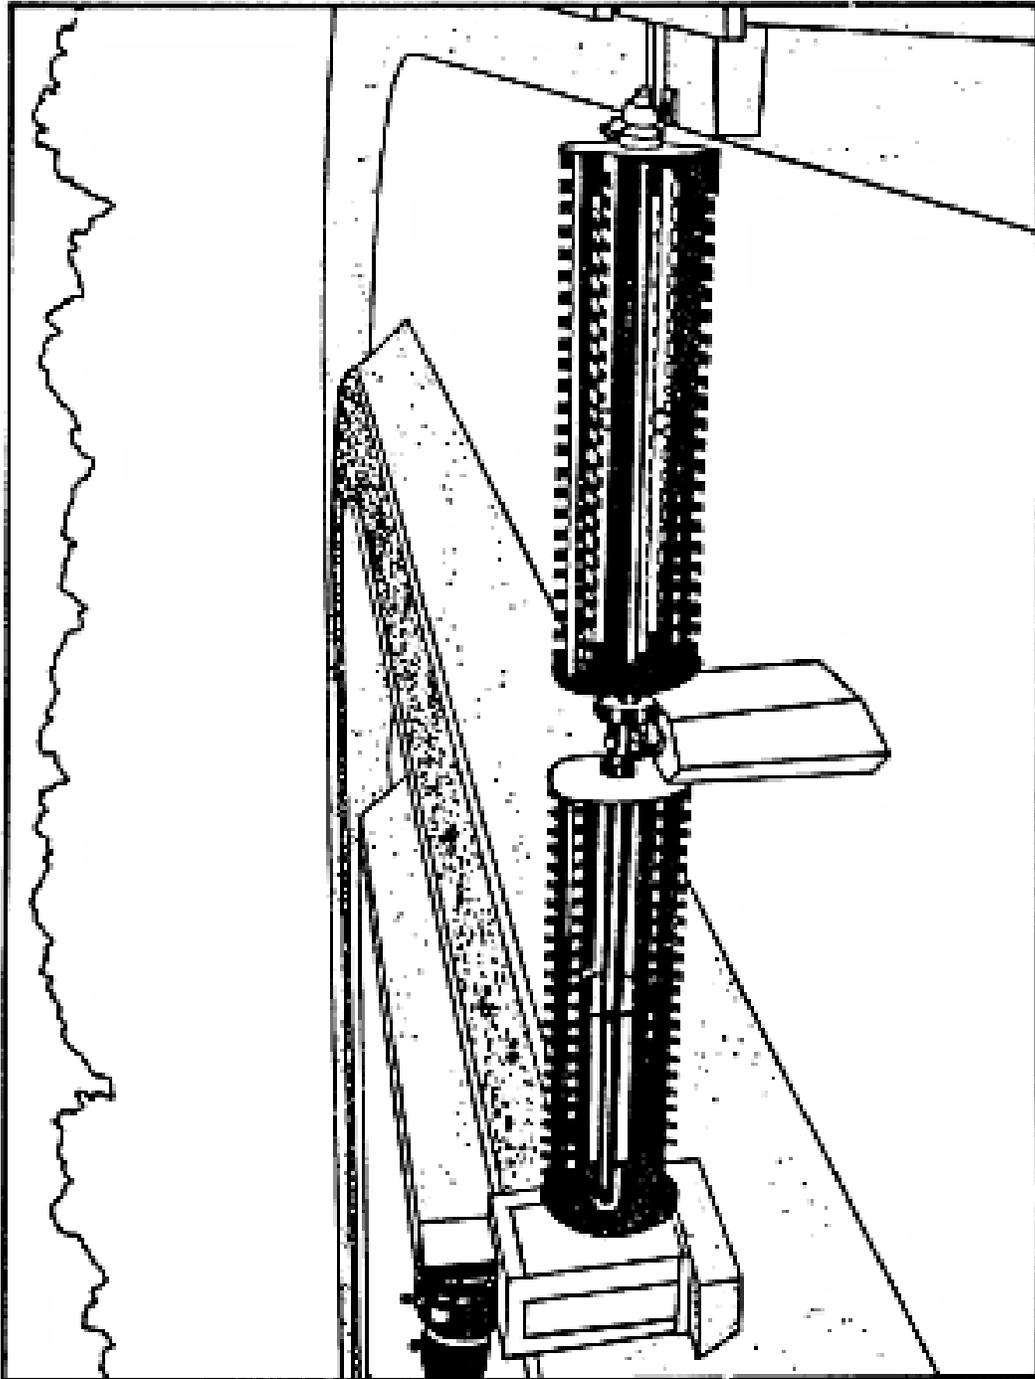



Figure 6
Horizontal shaft aerator




(a) Cup-type source bubbler



(b) Sacas wrapped tube diffuser




(c) noncing plate diffuser

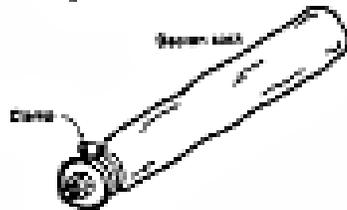


(d) flexparger




(e) Monoparge

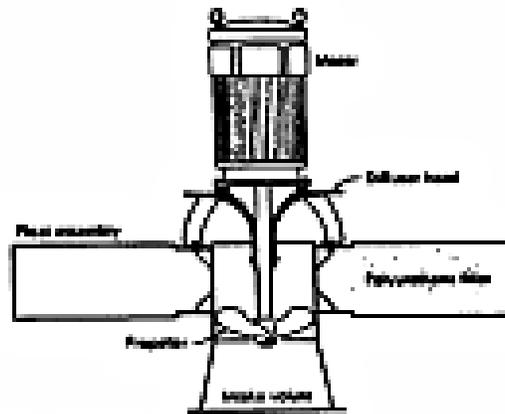

(f) floating mechanical surface aerator

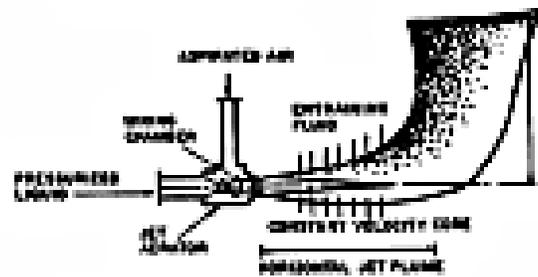

(g) jet aerator

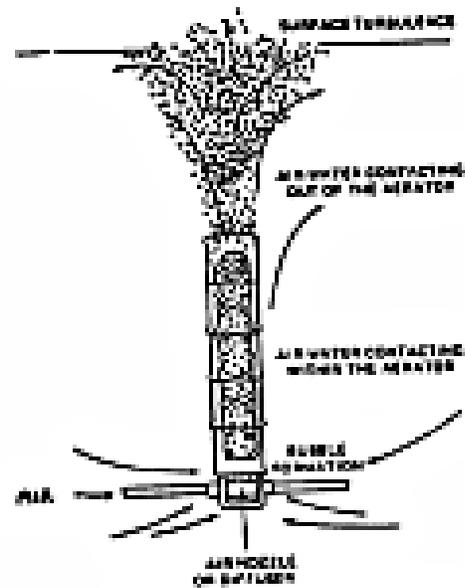

(h) vertical tube diffuser

Figure 7

Aerators

3.3.4 DIFFUSED AERATION PLUS SLOW MIXER. This type of aeration is more suitable for deep channels. Air bubbles are introduced into the mixed liquor through a pipe grid system with diffusers to provide oxygenation while a slow propeller mixer provides the flow circulation and mixing.

3.3.5 AERATOR SIZING. Aerators should be sized to provide adequate mixing and oxygenation. However, the same size rotor provides different levels of mixing and oxygenation depending on the degree of its submergence. First, the oxygen requirement must be calculated for a level that will satisfy the carbonaceous biochemical oxygen demand removal as well as nitrification-denitrification (if needed). Oxidation ditch equipment manufacturers provide tables or charts for selecting the aerator size for any given speed and submergence (immersion) based on the calculated oxygen requirement. The aerator size should also be checked against the mixing requirement set by the manufacturers. Preferably, more than one aerator should be used per channel; they should be placed at different locations so that if one breaks down, the channel will still function. The procedure for selecting the jet aerator size is similar except there is no submergence factor. The sizing of the induction aerator and the diffused air plus slow mixer units is not precise. Design data for these new aeration systems are not yet available. One reason for this is that the amount of energy required for mixing relative to the energy required for oxygenation is uncertain since it depends a great deal on the channel geometry, which varies among plants. More testing data must be collected before a design criterion can be established.

3.4 SLUDGE DEWATERING AND DISPOSAL. Sludge from oxidation ditch plants operating in the extended aeration mode (sludge retention time of 20 to 30 days) can be wasted directly to open drying beds. It can also be wasted directly to tank trucks which spread the liquid sludge on the plant grounds or on adjacent land. The degree of sludge stabilization in the oxidation ditch is equivalent to that of a conventional activated sludge plant operated at a 10-day sludge retention time followed by aerobic digestion of the sludge for 7 to 15 days. In most climates, 1.0 square foot of drying bed surface area per population equivalent (0.17 pound biochemical oxygen demand per capita per day)

should be used. This capacity can accept 2.2 cubic feet of wasted sludge per 100 capita per day, which is typical for domestic wastewater treatment. Double units of drying beds should be used so that half of them can be taken out of service for maintenance.

3.5 COLD CLIMATE. In moderately cold areas, ice buildup on clarifier scum collection boxes can cause problems and eventually jam the skimmer mechanisms. Therefore, final clarifiers should be covered. In cold areas, the spray from surface aerators will freeze on adjacent structures, bearings, gear reducers, etc., making maintenance difficult. Drive components and walkways near the aerators should be covered to shield them from spray, or mounted in isolated compartments. In very cold areas, heated covers for surface aerators should be provided. Ice fences should be installed across the channel upstream of brush-type aerators to prevent chunks of ice from breaking the brushes.

4. EXAMPLE CALCULATIONS

a. Activated sludge, closed-loop reactor.

a. The following design criteria are for an oxidation ditch with horizontal-shaft rotor aerators, using a single-channel, oval configuration and multiple units in parallel, operated in an extended aeration mode with nitrification.

Influent requirements:

Q, avg daily flow	= 1.0 mgd;
Q, peak flow	= 2.0 mgd;
BOD ₅	= 250 mg/b, typical of Army installations;
TSS	= 250 mg/b, typical of Army installations;
VSS	= 200 mg/b;
TKN	= 25 mg/b (all NH ₃ N);
P	= 8mg/b;
pH	= 6.5 to 8.5;
Minimum temp	= 10°C;
Maximum temp	= 25°C.

Effluent requirements:

BOD ₅	≤ 10 mg/b;
TKN	≤ 5 mg/b;
NH ₃ -N	≤ mg/b;
TSS	≤ 20 mg/b.

Waste characteristics:

$$Y = 0.8 \text{ lb solids produced/lb BOD}_5 \text{ removed;} \\ = \text{total sludge produced;} \\ k_d = 0.05 \text{ day}^{-1}.$$

Clarifier characteristics:

$$\text{Overflow rate} \leq 450 \text{ gpd/sq ft @ } Q_{avg}; \\ \text{Solid loading} \leq 30 \text{ lb/sq ft-day.}$$

Flow divided equally into two units in parallel, or $Q = 0.5$ mgd average daily flow each; the calculation shown below applies to either unit:

$$Q_{avg} = 0.5 \text{ mgd} = 347.2 \text{ gpm};$$

$$\text{Organic load} = 0.5 \text{ mgd} \times 250 \text{ mg/b} \times 8.34 = 1042.5 \text{ lb BOD/day.}$$

b. Calculation of oxidation ditch volume.

Use 20 lb BOD/1,000 cu ft—day;

$$V = \frac{1042.5 \text{ lb/day}}{20 \text{ lb/1,000 cu ft-day}} = 52,125 \text{ cu ft};$$

$$\text{Hydraulic detention time} = \frac{52,125 \times 7.48 \times 24}{0.5 \times 10^6} = 18.75 \text{ hr.}$$

c. Calculation of rotor requirements.

Rotor mixing requirement = 16,000 gal/ft of rotor; recommended by bakeside Equipment Corporation for maintaining a channel velocity of 1.0 fps.

$$\text{Length of rotor} = \frac{52,125 \cdot 7.48}{16,000} = 24.4; \text{ use } 25 \text{ ft.}$$

Oxygenation requirement = 2.35 lb O₂/lb BOD-recommended for domestic sewage. Assume the following operating conditions:

RPM = 72;

Immersion = 8 in.

Oxygenation = 3.75 lb O₂/hr-ft (from fig C-2), using a 42-in diameter MAGNA rotor.

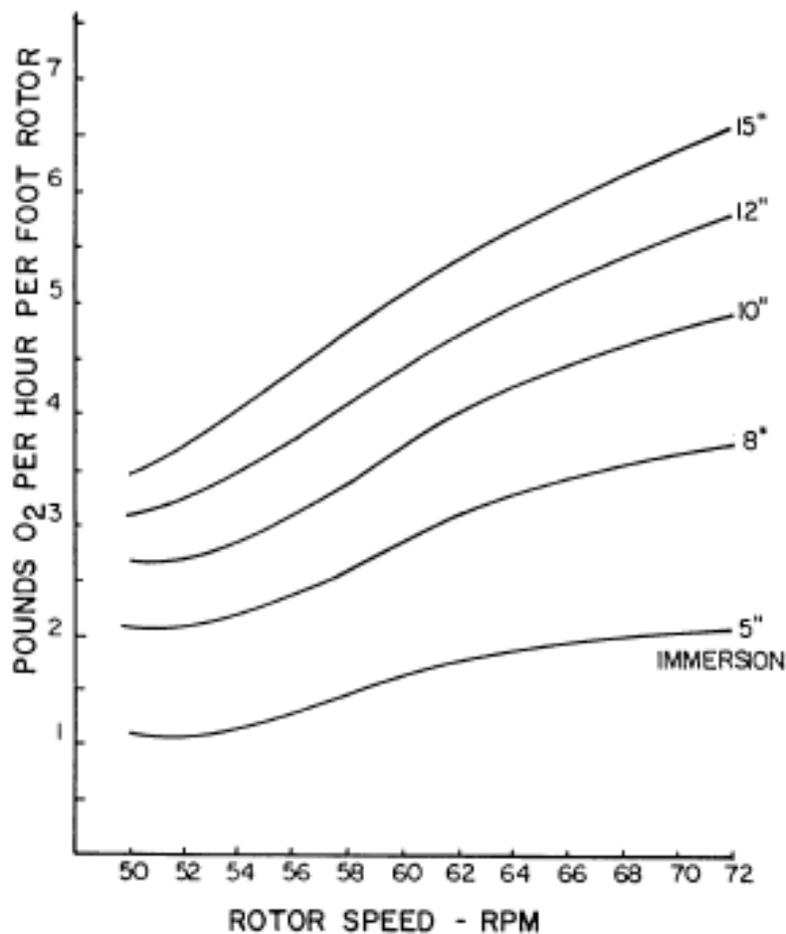


Figure C-2. Rotor aeration oxygenation capacity curve.

$$\text{Length of rotor} = \frac{1042.5 \times 2.35}{24 \times 3.75} = 27.2; \text{ use } 28 \text{ ft.}$$

Use two rotors per each unit oxidation ditch or 2- × 14-ft length rotor.

Theoretical oxygen transfer requirement:

$$\text{lb O}_2/\text{hr-ft} = \frac{1042.5 \times 2.35}{24 \times 28} = 3.65$$

Actual immersion = 8 in.

Power requirement = 0.84 kW/ft of rotor (from fig C-3), using 42-in diameter MAGNA rotor.

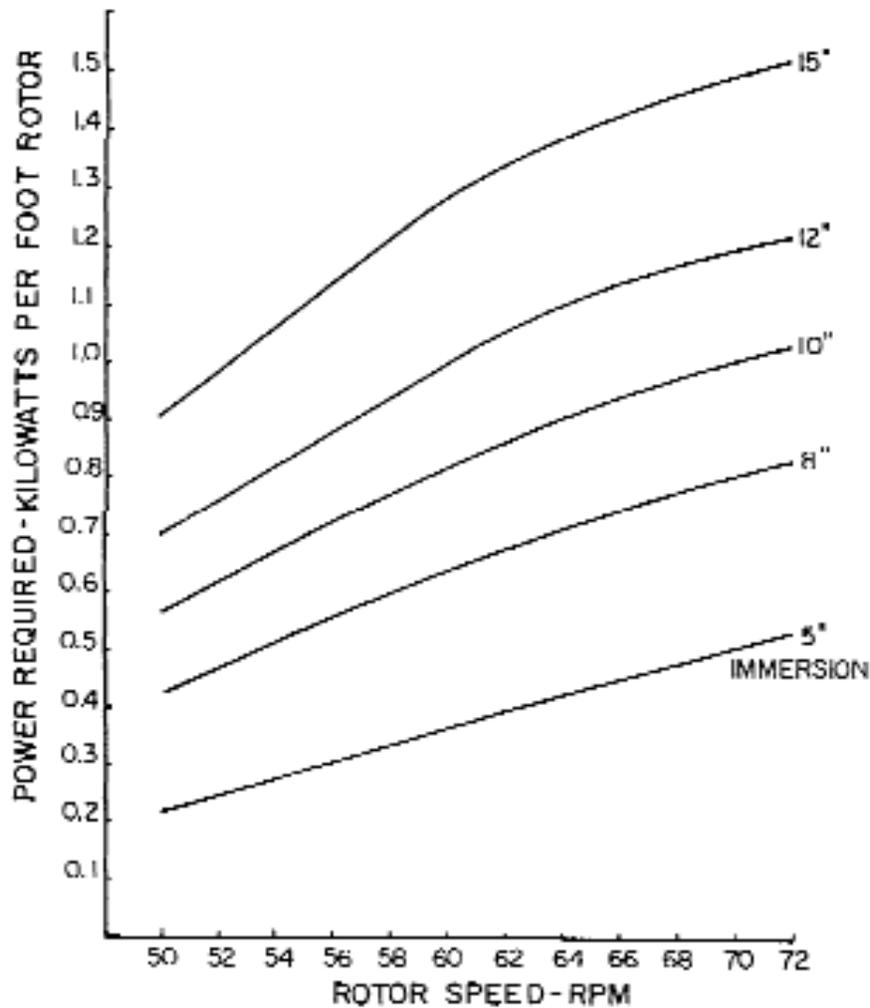


Figure C-3. Rotor aeration power requirements curves.

Aerator brake horsepower requirement = $1.34 \times 0.84 \times 14 = 15.75$ BHP for each rotor.

d. **Calculation of motor horsepower.** Size all motors to allow at least 1½ inch above the 8-in actual immersion to allow for peak flows.

Motor horsepower required at $(8 + 1.5) = 9.5$ in;

$$= \frac{0.99 \text{ BHP} \times 14 \times 1.34}{0.95} = 19.6 \text{ hp};$$

Use standard horsepower, or 20 hp each.

e. **Channel sizing** (fig C-4).

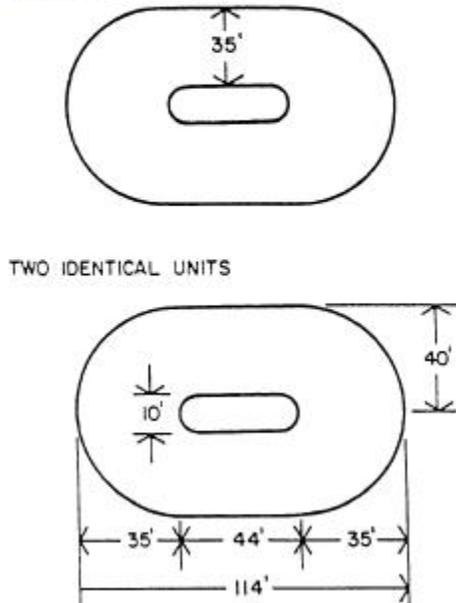


Figure C-4. Closed-loop reactor channel sizing

Ditch liquid volume = 52,125 cu ft.

Choose:

Depth: 10 ft;

Side wall slope: 45 degrees;

Median strip width: 10 ft;

Ditch flat bottom width = rotor length + 1.0 ft = $14 + 1 = 15$ ft;

Ditch width at water surface = $2 \times 10 + 15 = 35$ ft;

Ditch cross-section area = $\left(\frac{15 + 35}{2}\right) \times 10 = 250$ sq ft;

Curvature volume = $(2)(3.142)(22.5)(250) = 35,325$ cu ft (by Theorem of Pappus);

Ditch straight wall volume = $52,125 - 35,325 = 16,800$ cu ft;

Total length of the ditch at the waterline = $\frac{16,800}{2 \times 250} = 33.6$, or 34 ft;

Ditch width = $2(35) + 10 = 80$ ft;

Total ditch length = $34 + 80 = 114$ ft;

Overall ditch dimensions = 114 ft x 80 ft x 10 ft deep.

f. **Final clarifier.**

One clarifier required for each ditch unit (Spiraflo clarifier).

Overflow rate \leq 450 gpd/sq ft.

Detention time = 3 hr.

$$\text{Area required} = \frac{.05 \times 10^6}{1 \times 450} = 1,111 \text{ sq ft.}$$

$$\text{Diameter} = \left(\frac{1,111}{0.785} \right)^{0.5} = 37.6, \text{ use } 38 \text{ ft.}$$

$$\text{Actual area} = (38)^2 \times 0.785 = 1133.5 \text{ sq ft.}$$

$$\text{Actual overflow rate} = \frac{0.5 \times 10^6}{1133.5} = 441 \text{ gpd/sq ft.}$$


$$\text{Volume} = \frac{0.5 \times 10^6 \times 3}{24 \times 7.48 \times 1} = 8356.5 \text{ cu ft.}$$

$$\text{Straight wall dept} = \left(\frac{8356.5}{1133.5} \right) = 7.4 \text{ ft, use } 8 \text{ ft.}$$

$$\text{Actual detention time} = 8 \times 1133.5 \times 24 \times 7.48 / 0.5 \times 10^6 = 3.25 \text{ hr.}$$

g. **Check for nitrification in oxidation ditch.** Find MLVSS concentration required at standard conditions (20°C, pH8.5) to completely nitrify ammonia shown in figure C-5.

Figure 5-6. Nitrate nitrogen

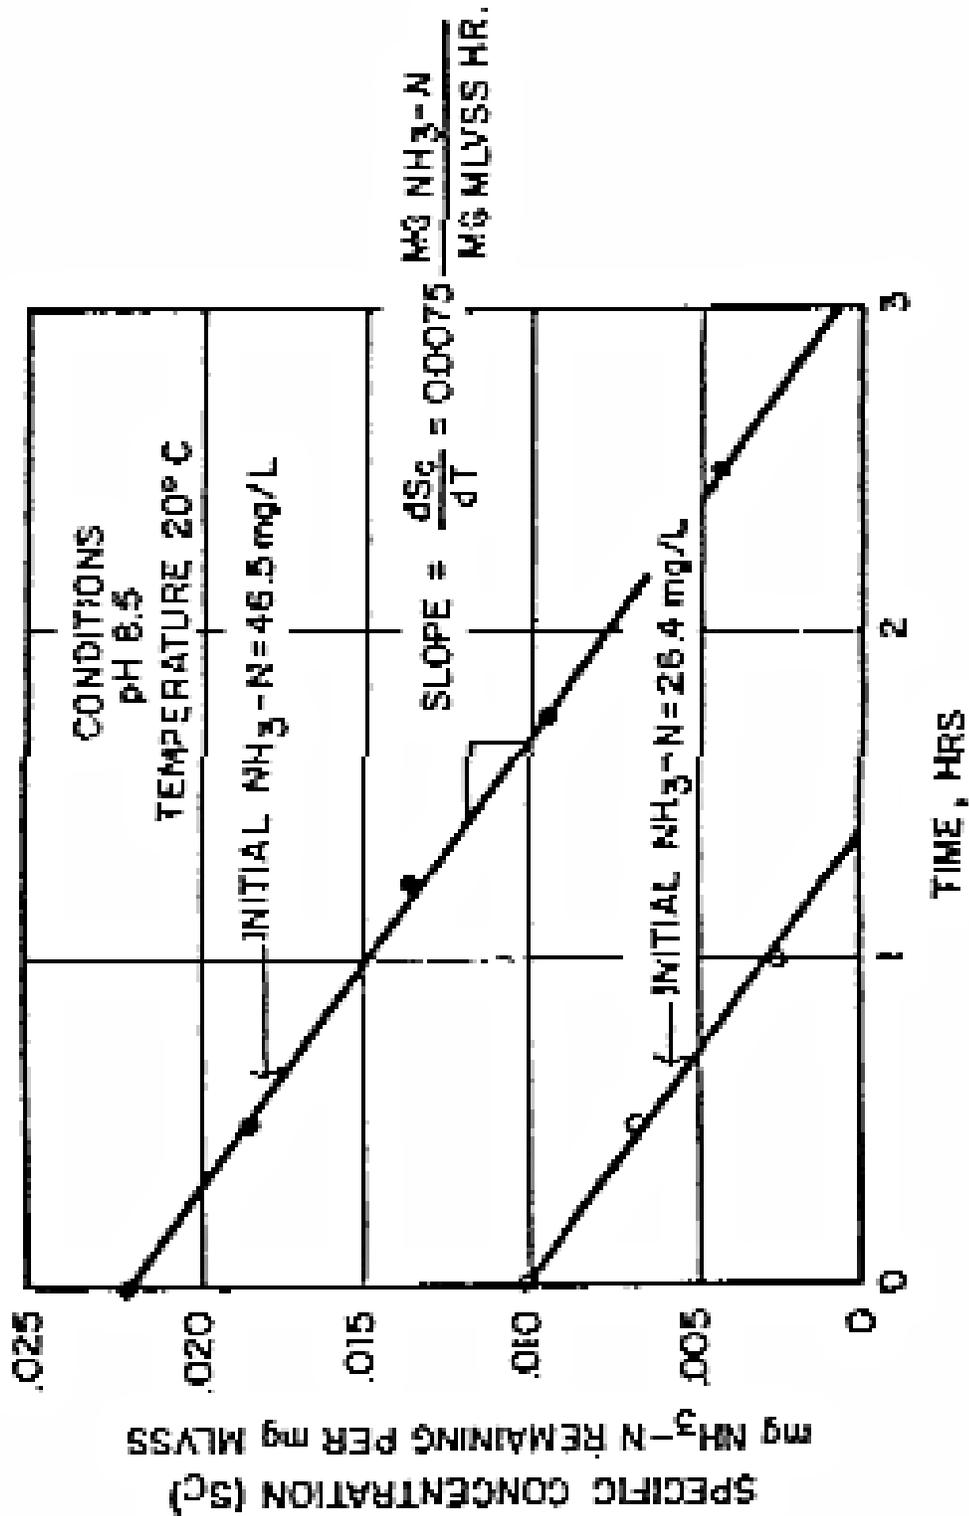

$$\text{MLVSS} = \frac{1}{0.0075} \times \frac{25 \text{ mg/L } \text{NH}_4\text{-N}}{18.75 \text{ hr}} = 177.8 \text{ mg/L}$$

where 0.0075 mg NH₄^{-N}/mg MLVSS-hr is the rate of nitrification given in figure C-5.

Change MLVSS concentration at standard conditions to design conditions (10°C, pH 6.5 to 8.5[assume pH is 7.0]), using figures C-6 and C-7 for temperature and pH corrections.

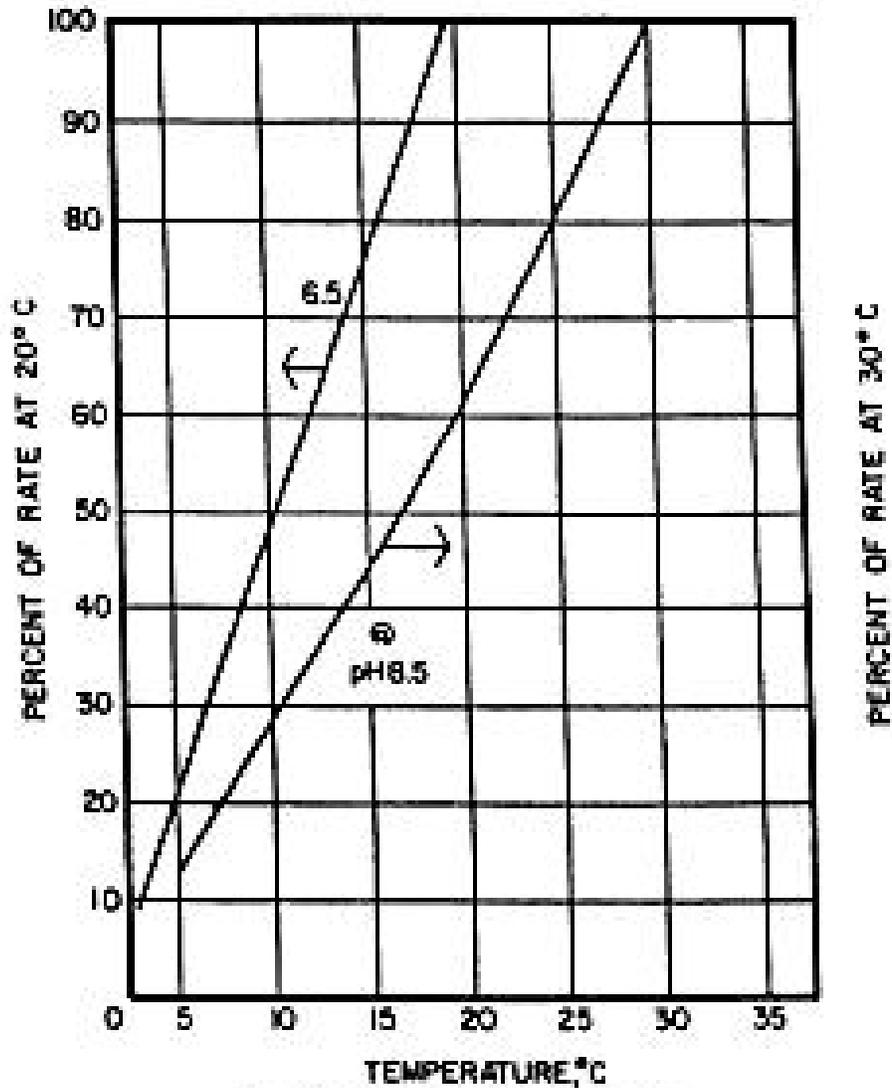


Figure C-6. Nitrification temperature correction.

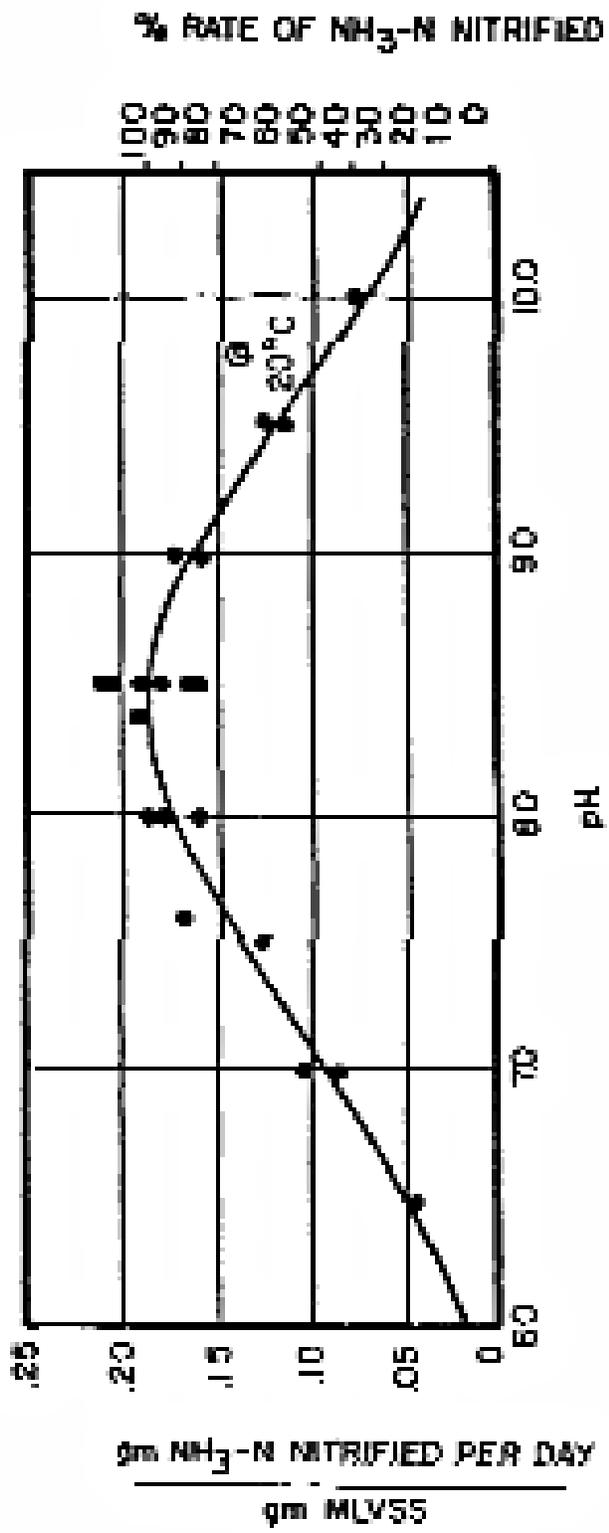


Figure 6-7. Relationship of nitrification

Temperature correction = 0.46 (from 20°C to 10°C),
 pH correction = 0.50 (pH 8.5 to 7.0),

$$\text{MLVSS concentration} = \frac{177.8 \text{ mg/L}}{0.46 \times 0.50} = 774 \text{ mg/L.}$$

This concentration is low; the sludge age would be too short to give a stable performance. To obtain a stabilized sludge:

Use 3200 MLVSS,

$$\text{MLVSS} = \frac{3200}{0.8} = 4000 \text{ mg/L.}$$

Check sludge age (with negligible sludge wasting):

$$c = \frac{\text{MLVSS}}{Y(\text{BOD})} = \frac{3200}{0.8(250)} = 16 \text{ days.}$$

This sludge age is considered adequate.

- k. Check size of final clarifier with solids loading.
 Spiralflo clarifier allows 30 lb solids/sq ft-day.

$$\text{Actual solids loading} = \frac{(441 \text{ gpd/sq ft})(8.34)(4000)}{500,000} = 29.4 \text{ lb/sq ft-day} < 30.$$

- i. Adjustable oxidation ditch weir. A weir on each oxidation ditch is provided and sized so that the head differential over the weir between the maximum and minimum flow rates is less than 1.25 in.

Maximum flow rate = Q_{max} + maximum recirculation rate;

Minimum flow rate = Q_{min} + recirculation rate.

For average daily flows between 200,000 gal/day to 1 mgd, the length (L) of the overflow weir is:

$$L = \frac{3.5 \times Q_{avg} \text{ gpm}}{102} = \frac{3.5 \times 347.2}{102} = 11.9, \text{ use } 12 \text{ ft.}$$

- j. Calculate the return sludge flow rate, Q_R :

The equipment manufacturer recommends the following:

Minimum pumping capacity = $0.25 \times Q_{avg} = 0.25 \times 347.2 \text{ gpm} = 87 \text{ gpm.}$

Maximum pumping capacity = $1.0 \times Q_{avg} = 1.0 \times 347.2 \text{ gpm} = 347 \text{ gpm.}$

2 pumps, each with 44 to 174 gpm capacity.

- k. Calculate amount of sludge for disposal. The amount of sludge wasted is the same as in the vertical-shaft aerator example since the influent and effluent characteristics and the MLVSS concentrations are identical.

$P_x = 683.2$ lb/day of VSS from 2 oxidation ditches.

Total sludge 933.4 lb/day dry solids from 2 oxidation ditches.

2 pumps, each with a capacity of 120 gpm for a 52-min/day wasting schedule as in the vertical-shaft aerator example.

- l. Sizing of sludge drying beds.

$$\text{BOD population equivalent} = \frac{1 \times 250 \times 8.34}{0.17} = 12,265 \text{ persons;}$$

Drying bed area = $12,265 \times 1 \text{ sq ft/cap} = 12,265 \text{ sq ft.}$

Use 10 drying beds, each at 35 ft \times 35 ft.

Total area = 12,250 sq ft.

Table C-4 summarizes the design criteria for the horizontal-shaft aerators and multiple-ditch units.

Table C-4. Summary of closed-loop reactor design.

Quantity	Unit	Size
2	Oval-shaped oxidation ditch with 10-ft wide median strip; 45 degree slope. Lining using gunite or shotcrete method of construction.	114 ft x 80 ft, 10 ft deep
4	Horizontal-shaft rotor aerator; 2 ea in oxidation ditch	14 ft long ea; 16 BHP ea (motor 20 hp)
2	Secondary clarifier.	38 ft dia x 8 ft SWD (Sprafkin clarifier)
2	Return sludge pump.	0.135 to 0.5 mgd ea (41 to 174 gpm)
2	Sludge wasting pump.	120 gpm ea
2	Adjustable oxidation ditch weir.	12 ft ea
10	Sludge drying bed	35 ft x 35 ft ea

5. REFERENCES

5.1 GOVERNMENT PUBLICATIONS

PL 92-500 Federal Water Pollution Control Act

5.1.1 DEPARTMENT OF DEFENSE

AFM 88-15 Air Force Design Manual-Criteria and Standards for Air Force Construction

AFP 19-5 Environmental Quality Control Handbook: Industrial Wastes

AFR 19-1 Pollution Abatement and Environmental Quality

AR 200-1 Environmental Protection and Enhancement

TM 5-813-5/AFM 88-10, Vol.5 Water Supply Water Distribution Systems

TM 5-814-1/AFM 88-11, Vol.1 Sanitary and Industrial Waste Sewers

TM 5-814-2/AFM 88-11, Vol.2 Sanitary and Industrial Wastewater Collection—Pumping Stations and Force Mains

TM 5-814-6 Industrial Wastes

TM 5-814-8 Evaluation Criteria Guide for Water Pollution: Prevention, Control, and Abatement

TM 5-852-1/AFR 88-19, Vol.1 Arctic and Subarctic Construction: General Provisions

TM 5-852-4/AFM 88-19, Chap. 4 Arctic and Subarctic Construction: Building Foundations

TM 5-852-5/AFR 88-19, Vol.5 Arctic and Subarctic Construction: Utilities

5.1.2 ENVIRONMENTAL PROTECTION AGENCY (EPA)

R-2-73-199 Application of Plastic Media Trickling Filters for Biological Nitrification Systems

625/1-74-006 Process Design Manual for Sludge Treatment and Disposal (Oct 74)

625/1-75-003a Process Design Manual for Suspended Solids Removal (Jan 75)

625/1-76-001a Process Design Manual For Phosphorus Removal (Oct 71)

625/1-80-012 Process Design Manual for Onsite Wastewater Treatment and Disposal Systems (Oct 80)

625/1-81-013 Process Design Manual for Land Treatment of Municipal Wastewater (Oct 81)

625/1-82-014 Process Design Manual for Dewatering Municipal Wastewater Sludges (Oct 82)

625/1-83-015 Process Design Manual for Municipal Wastewater Stabilization Ponds (Oct 83)

Process Design Manual for Carbon Absorbtion (Oct 73)

Process Design Manual for Nitrogen Control (Oct 75)

Process Design Manual for Upgrading Exist-Wastewater Treatment Plants (Oct 75)

Handbook for Monitoring Industrial Wastewater (Aug 73)

5.2 NON-GOVERNMENT PUBLICATIONS

5.2.1 AMERICAN WATERWORKS ASSOCIATION (AWWA)

6666 West Quincey Avenue, Denver CO 80235

Standard Methods for the Examination of Water and Wastewater

16th Edition, Franson, M.A. (ed), APHA, WPCF (1984)

Safety Practices for Water Utilities

5.2.2 WATER POLLUTION CONTROL FEDERATION (WPCF)

Manual of Practice No.1 Safety and Health in Wastewater Works (1983)

Manual of Practice No.8 Wastewater Treatment Plant Design (1977)

6. BIBLIOGRAPHY

Alter, A.J. Sewage and sewage disposal in cold regions. U.S. Army Cold Regions Research and Engineering Laboratory. Monograph III-C5b, 106 pp, 1969.

Alter, A.J. Water supply in cold regions. Cold Regions Science and Engineering Monograph III-C52. U.S. Army Cold Regions Research and Engineering Laboratory, Hanover NH, January, 1969.

American Society of Agricultural Engineers. *On-Site Sewage Treatment*, American Society of Agricultural Engineers, Publication 1-82, St. Joseph MO 49085, 1984.

Babbitt, H.E. and Baumann, E.R., *Sewerage and Sewage Treatment*, New York: John Wiley, 1958.

Bandy, J.T., Poon, C.P.C., and Smith, E.D., *Oxidation Ditch Technology for Upgrading Army Sewage Treatment Facilities*, 1983.

Barnes, D., Bliss, P.J., Gould, B.W., and Vallentine, H.R., *Water and Wastewater Engineering Systems*, Pitman Books Ltd., London, 1981.

Barnes, D., and Wilson, F., *Design and Operation of Small Sewage Works*, Halsted Press, 1976.

Bitton, G., et al., *Sludge: Health Risks of Land Application*, Ann Arbor Science, 1980.

Borchardt, J.S., et al. (eds.), *Sludge and Its Ultimate Disposal*, Jones and Redman, Ann Arbor Science, 1981.

Bouwer, H., Rice, R.C., and Escarcega, E.D., *High-Rate Land Treatment I: Infiltration and Hydraulic Aspects of the Flushing Meadow Project*. Journal WPCF 46: 834-843, 1974.

Boyle, WC., and Otis, R.J., *On-Site Treatment*, Environmental Research Information Center; Office of Research and Development, U.S. EPA, Cincinnati OH 45268, 1982.

Bruce, A.M., et al., *Disinfection of Sludge: Technical, Economic and Microbiological Aspects*, D. Reidel Publishing Company, Dordrecht, Holland, 1980.

Chemical Engineering Catalog, *Equipment and Materials for the Process Industries*, Reinhold Publishing Co., Stamford CT, 06904.

Cohen, S., and Wallman, H., *Demonstration of Waste Flow Reduction from Households*, No. PB 236904/AS NTIS, Department of Commerce, Springfield VA 22151.

Culp, R.L., and Culp, G.L., *Advanced Wastewater Treatment*, Van Nostrand-Reinhold, New York, 1971.

Curds, C.R., and Hawkes, H.A., *Ecological Aspects of Used Water Treatment*, Volume 1, Academic Press, 1975.

Deese, PL. and Hudson, J.F., *Planning Wastewater Management Facilities for Small Communities*, Municipal Environmental Research Laboratory, Office of Research and Development, U.S. EPA, Cincinnati OH 45268.

Diaper, E.W., *Tertiary Treatment by Microstraining*, Water and Sewage Works, June 1969.

Dinges, R., *Natural Systems for Water Pollution Control*, Environmental Engineers Series, Van Nostrand- Reinhold, New York, 1984.

D'Itri, F.M., *Land Treatment of Municipal Wastewater, Vegetation Selection and Management*, Ann Arbor Science, 1982.

D'Itri, F., et al., *Municipal Wastewater in Agriculture*, Academic Press, 1984.

Ehreth, D.J., and Basilico, J.V., *An Overview of Nitrogen Control Technology in Municipal Wastewater Treatment*, Technical Paper presented 4th Joint Chemical Engineering Conference, Vancouver BC, Canada, 10 September 1973.

Eikum, A., *Treatment of Septic Sludge-European Practice*, Norwegian Institute for Water Research, 0-80040, 1982.

Eikum, A.S., and Seabloom, R.W., *Alternative Wastewater Treatment*, (Reidel-Holland), Kluwer- Academic, 1982.

Fair, G.M., Geyer, J.C., and Okun, D.A., *Water and Wastewater Engineering*, John Wiley, New York, 1966.

Fay, S.C., and Walke, R.H., *The Composting Option for Human Waste Disposal in the Backcountry*, Forest Service Research Note NE-246, N.E. Forest Service, USDA, Upper Darby PA 19082, 1975.

Ferguson, B.K., *Landscape Hydrology: A Unified Guide to Water-Related Design, In the Landscape: Critical Issues and Resources*, Conference of Council on Education in Landscape Architecture, Utah State University, Logan UT, 1980.

Gehm, H.W., and Bregman, J.I., *Handbook of Water Resources and Pollution Control*, Van Nostrand-Reinhold, New York, 1976.

Grady and Lim, *Biological Wastewater Treatment: Theory and Applications*, Pollution Engineering and Technology Series: Volume 12, Dekker, 1985.

Harris, S.E., Reynolds, J.J., Hill, DW, Filip, D.S., and Middlebrooks, E.J., *Intermittant Sand Filtration for Upgrading Waste Stabilization Pond Effluents*, JWPCF 49:83-102, 1977.

Hartenstein, R., and Mitchell, M.J., *Utilization of Earthworms and Micro-organisms in Stabilization and Detoxification of Residue Sludges from Treatment of Wastewaters*, NSF Report, Grant ENV-7-06994, 1978.

Howland, WE., *Flow over Porous Media as in a Trickling Filter* Proceedings in 12th Purdue Industrial Waste Conference, pp.435-465, 1957.

Hutzler, N.J., Otis, R.J., and Boyle, WC., *Field and Laboratory Studies of Onsite Household Wastewater Treatment Alternatives*, Proceedings of Ohio Home Sewage Disposal Conference, Ohio State University, Columbus OH 1984.

Kardos, L.T., Sopper, WE., Myers, E.A., Parizek, R.R., and Nesbitt, J.B., *Renovation of Secondary Effluent for Re-use as a Water Resource*, Office of Research and Development, U.S. EPA, EPA-66012-74-016, 1974.

Kruse, CW, et al., *Improvement in Terminal Disinfection of Sewage Effluents*, Water & Sewage Works, June 1973.

Liech, H., *New Options for a Sewerless Society*, Compost Science, Summer 1976.

Linell, K.A., and Johnston, G.H., *Engineering Design and Construction in Permafrost Regions: A Review*, in *North American Contribution, Permafrost: Second International Conference*, 19763, pp.553-575, National Academy of Sciences, Washington DC, 1973.

Lynam, B., et al., *Tertiary Treatment at Metro Chicago by Means of Rapid Sand Filtration and Microstrainers*, WPCF Journal, February 1969.

Metcalf and Eddy, Inc., *Wastewater Engineering*, McGraw Hill, New York, 1972.

Michigan State University, Institute of Water Research, *Utilization of Natural Ecosystems for Wastewater Renovation*, Final Report for Region V Office, U.S. EPA, East Lansing MI, 1976.

National Research Council of Canada, *Permafrost Engineering Design and Construction*, prepared by the Committee on Geotechnical Research, National Research Council of Canada, John Wiley & Sons, New York, 1981.

Office of Appropriate Technology, *Rural Wastewater Disposal Alternatives*, Final Report Phase I, State Water Resources Control Board, State of California, Governor's Office of Planning and Research, #750.

Otis, R.J., et al., U.S. Environmental Protection Agency, *Alternatives for Small Treatment Systems, Onsite Disposal/Septage Treatment and Disposal*, U.S. EPA Technology Transfer SEMinar Publication 625/4-77-011, 1977.

Parker, HW, and Bregman, J.I., *Wastewater Systems Engineering*, Prentice-Hall, Englewood Cliffs, 1975.

Parr, J.F., et al., *Current Research on Composting of Sewage Sludge*, Process Conference on Utilization of Soil Organisms in Sludge Management, State University of New York, Syracuse NY, 1982.

Rich, L.G., *Low Maintenance, Mechanically Simple Wastewater Treatment Systems*, Water Resources and Environmental Engineering Series, McGraw-Hill, Hightstown NJ 08520, 1980.

Renayne, M.P, Paeth, R.C., and Osbourne, T.J., *Intermittant Sand Filter Design and Performance: An Update*, In Proceedings, 4th NW. Onsite Wastewater Disposal Short Course, University of Washington, Seattle WA, 1982.

Ryan, W, *Design Guidelines for Piping Systems*, In *Utilities Delivery in Arctic Regions*, Environmental Protection Service, Ottawa ONT Canada, EPA 3-WP-77-1, 1977.

Safety in Wastewater Works, Water Pollution Control Federation Manual of Practice No.1, 1975. Safety Practice for Water Utilities, American Water Works Association, No.30040.

Sanks, R.L., and Asano, T., *Land Treatment and Disposal of Municipal and Industrial Wastewater*, Ann Arbor Science Publishing, Inc., Ann Arbor MI 48106, 1976.

Seabloom, RW, DeWalle, F., and Plews, G., *Implementation of New and Old Technologies*, 4th Northwest Onsite Water Disposal Short Course, State of Washington, Department of Social and Health Services, LD-11, Olympia WA, 1978.

Siegrist, R.L., and Boyle, WC., *Onsite Reclamation of Residential Greywater*, In American Society of Agricultural Engineers, Onsite Sewage Treatment, ASAE Pub. 1-82, 1982.

Singley, M.E., Higgins, A.J., and Frumkin-Rosengaus, M., *Sludge Composting and Utilization*, The State University of New Jersey, 1982.

Smith, D.W, and Hrudey, SE., *Design of Water and Wastewater Services for Cold Climate Communities*, Seminar at 10th IAWPR Conference, Edmonton ALB Canada, June 1980.

Sopper, W.E., and Kerr, S.N., *Utilization of Municipal Sewage Effluent and Sludge on Forest and Disturbed Land*, Pennsylvania State University Press, 1979.

Standard Methods for the Examination of Water and Wastewater, 14th Edition, APHA, AWWA, WPCF 1975.

Tchobanoglous, G., *Filtration Techniques in Tertiary Treatment*, WPCF Journal, April 1970.

Thornton, D.E., *Calculation of Heat Loss From Pipes*, In *Utilities Delivery in Arctic Regions*, Environmental Protection Service, Environment Canada, Report No. EPA 3-WP-77-1, pp. 131-150, Ottawa, 1977.

Tilsworth, T., *Sludge Production and Disposal for Small Cold Climate Bio-treatment Plants*, Institute of Water Resources Report No. IWR-32, University of Alaska, Fairbanks, 1972.

U.S. Environmental Protection Agency, *Pretreatment of Pollutants Introduced into Publicly Owned Treatment Works*, Federal Guidelines, October 1973.

U.S. Environmental Protection Agency, *Process Design Manual for Wastewater Treatment Facilities for Sewered Small Communities*, Technology Transfer Series, EPA Publication 625 1-77-009, October 1983.

Wagner, E.G., and Lanoix, J.N., *Excreta Control for Rural Area*, World Health Organization, Palais des Nations, Geneva, 1982.

Winkler, M. *Biological Treatment of Wastewater*, Halsted Press, 1981.

Winneberger, J.H.T. (ed.), *Manual of Greywater Treatment Practice*, Ann Arbor Science Publishing, Inc., Ann Arbor MI 48106, 1976.

Yonika, D., Lowry, D., Hollands, G., et al., *Feasibility Study of Westland Disposal of Wastewater Treatment Plant Effluent*, Massachusetts Water Research Commission, Final Research Project Report 78-04, 1978.

QUIZ

An Introduction to Activated Sludge Wastewater Treatment Plants

1. In a conventional (plug-flow) activated sludge plant, the primary-treated wastewater and acclimated micro-organisms (activated sludge or biomass) are _____ in a basin or tank.
 - a. flocculated
 - b. aerated
 - c. diluted
 - d. concentrated
2. In the step aeration process, the influent wastewater is introduced at various points along the length of the aeration tank. Sludge return varies between _____ percent.
 - a. 5 and 15
 - b. 15 and 25
 - c. 25 and 50
 - d. 50 and 75
3. The contact stabilization activated sludge process is characterized by a two-step aeration system. Aeration of short duration (_____ hours) is provided in the contact tank where raw or primary-settled wastewater is mixed with the activated sludge in the contact tank.
 - a. 12 to 24
 - b. 4 to 8
 - c. $\frac{1}{2}$ to 2
 - d. variable
4. In the completely-mixed process, influent wastewater and the _____ are introduced uniformly through the aeration tank.
 - a. recycled sludge
 - b. flocculant
 - c. effluent
 - d. nitrite additives

5. Extended aeration activated sludge plants are designed to provide a 24-hour aeration period for low organic loadings of less than _____ pounds biochemical oxygen demand per 1,000 cubic feet of aeration tank volume.

- a. 100
- b. 50
- c. 20
- d. 5

6. The closed-loop reactor, also known as a/an _____, is a form of the extended aeration process.

- a. oxidation ditch
- b. recharge plant
- c. land application process
- d. anoxic process

7. Typical hydraulic retention time for a closed-loop reactor plant is _____.

- a. 3 to 5 days
- b. 24 to 48 hours
- c. 18 to 24 hours
- d. 8 to 12 hours

8. Typical sludge retention time for a closed-loop reactor plant is _____.

- a. 20 to 30 days
- b. 15 to 25 days
- c. 3 to 5 days
- d. 24 to 48 hours

9. In a closed loop reactor plant, the number of _____ and the channel depth are dependent upon the size of the plant.

- a. loops
- b. clarifiers
- c. settling basins
- d. influent ports

10. A/an _____ is a horizontal shaft with protruding blades which rotates, thereby transferring oxygen into the wastewater and propelling it around the ditch.

- a. acquifier
- b. rotor aerator
- c. injector
- d. rectifier

11. An induction aerator draws the mixed liquor and air down a _____ and discharges it for a distance downstream in the channel.

- a. vertical column
- b. U-tube
- c. tapered channel
- d. concentric column

12. Jet aeration is specifically designed for _____ .

- a. contact stabilization plants
- b. closed-loop reactors
- c. deep channels
- d. multiple filters

13. Diffused aeration plus slow mixer is more suitable for _____ .

- a. shallow channels
- b. induction aerators
- c. deep channels
- d. closed loop plants

14. In moderately cold areas, ice buildup on _____ scum collection boxes can cause problems and eventually jam the skimmer mechanisms.

- a. aerator
- b. influent
- c. effluent
- d. clarifier

15. In very cold areas, heated covers for _____ should be provided.

- a. sludge drainage channels
- b. surface aerators
- c. skimmers
- d. floc beds